


EST #:	*
JOB #:	*
ITEM #:	*

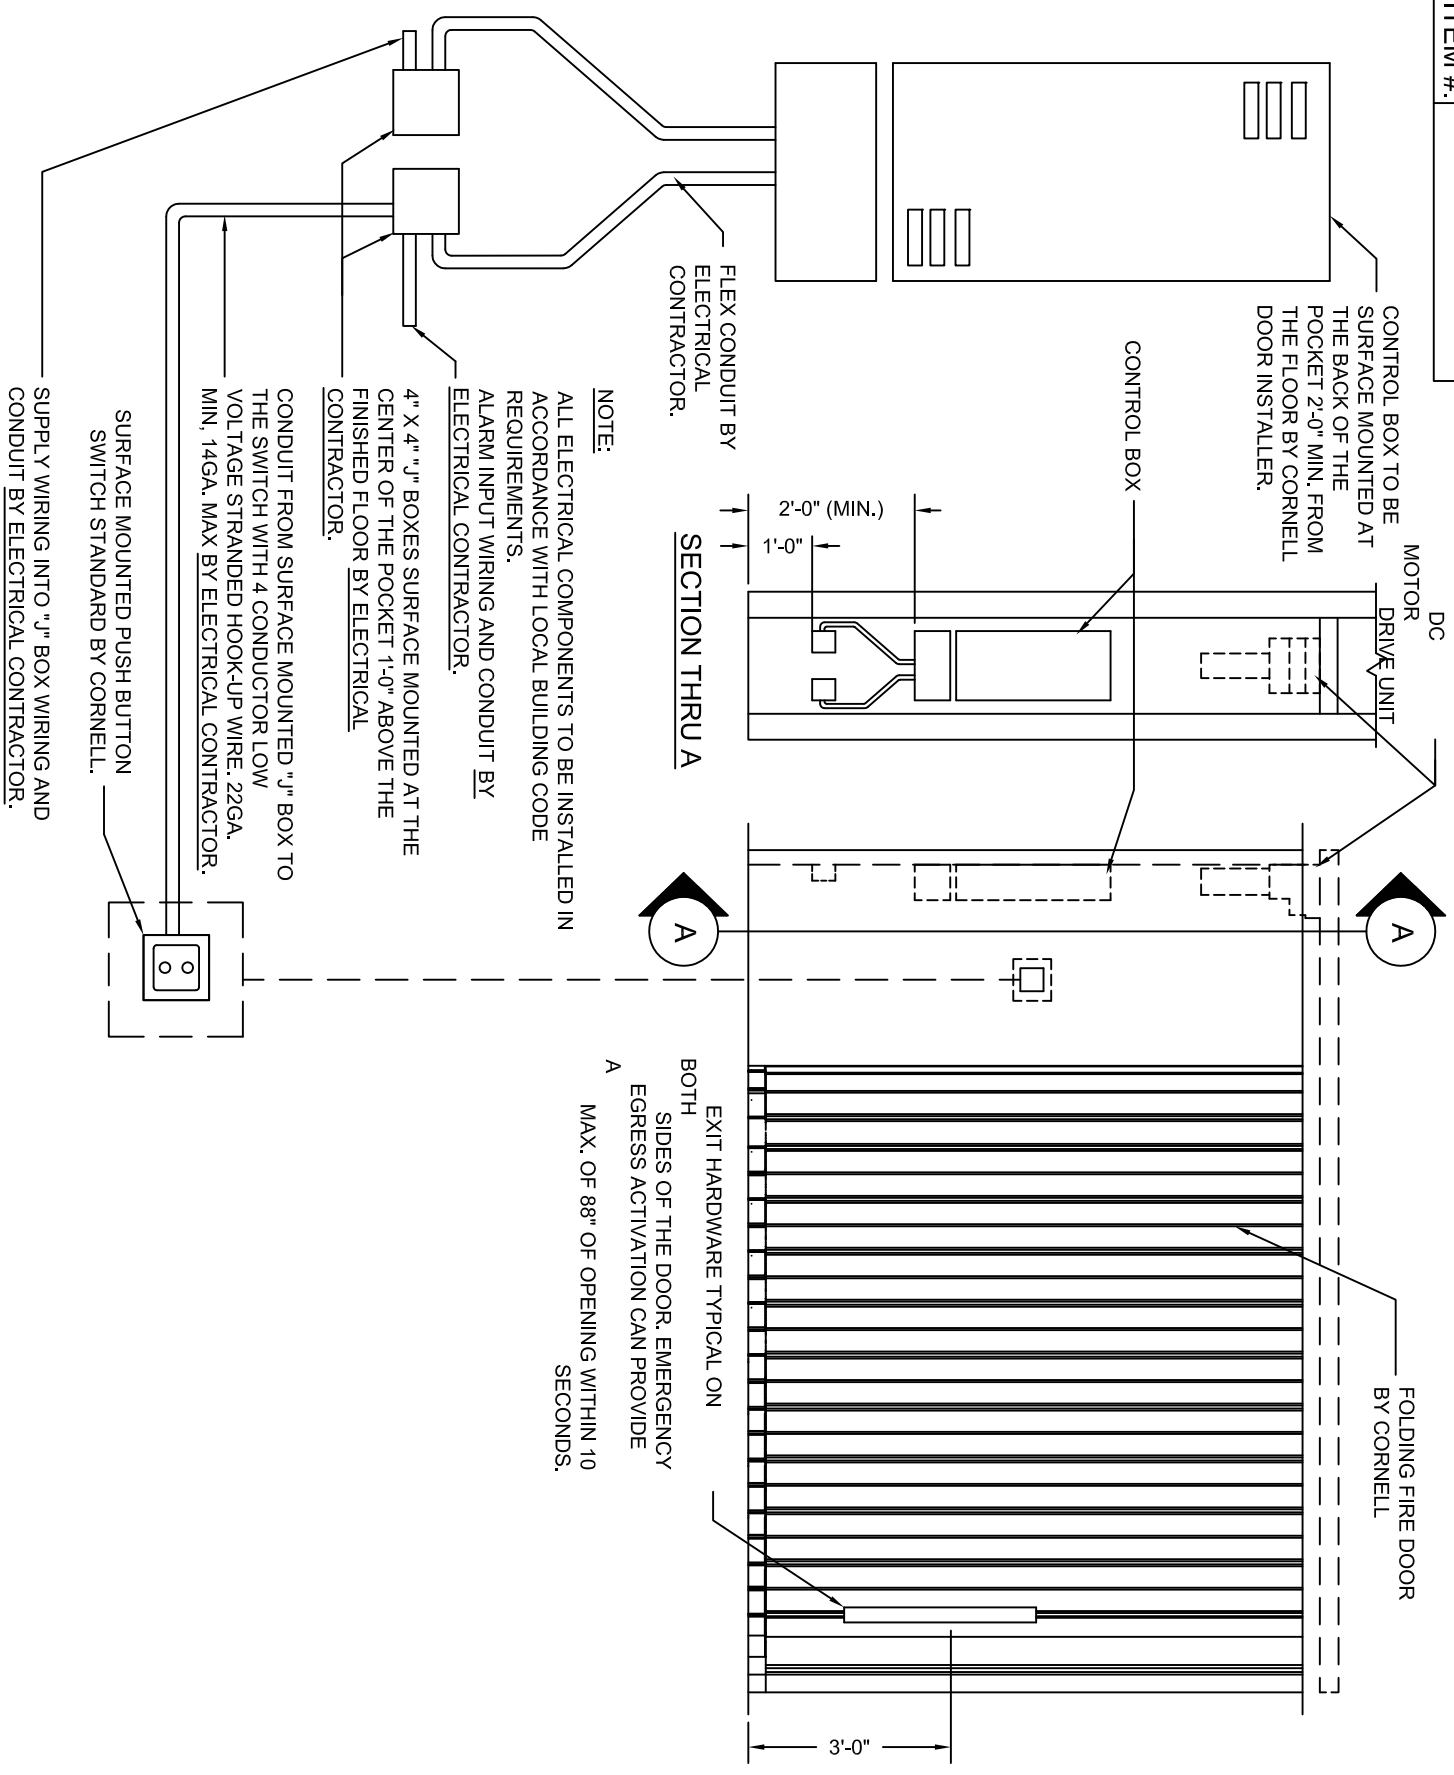

NOTE:
 ALL ELECTRICAL COMPONENTS TO BE INSTALLED IN ACCORDANCE WITH LOCAL BUILDING CODE REQUIREMENTS.
 ALARM INPUT WIRING AND CONDUIT BY ELECTRICAL CONTRACTOR.

4" X 4" "J" BOXES SURFACE MOUNTED AT THE CENTER OF THE POCKET 1'-0" ABOVE THE FINISHED FLOOR BY ELECTRICAL CONTRACTOR.

CONDUIT FROM SURFACE MOUNTED "J" BOX TO THE SWITCH WITH 4 CONDUCTOR LOW VOLTAGE STRANDED HOOK-UP WIRE .22GA. MIN, 14GA. MAX BY ELECTRICAL CONTRACTOR.

SURFACE MOUNTED PUSH BUTTON SWITCH STANDARD BY CORNELL.

SUPPLY WIRING INTO "J" BOX WIRING AND CONDUIT BY ELECTRICAL CONTRACTOR.

EXIT HARDWARE TYPICAL ON BOTH SIDES OF THE DOOR. EMERGENCY EGRESS ACTIVATION CAN PROVIDE MAX. OF 88" OF OPENING WITHIN 10 SECONDS.

FOLDING FIRE DOOR BY CORNELL

TRANSFORM 3 HR FIRE

